


OWNER		ADDRESS		
PREPARED BY		DATE	COUNTY	
CHECKED BY	DATE	JOB NO.	SHEET	OF

BENCH MARK DESCRIPTION:	SCALE 1" = _____ FT.

[illegible]

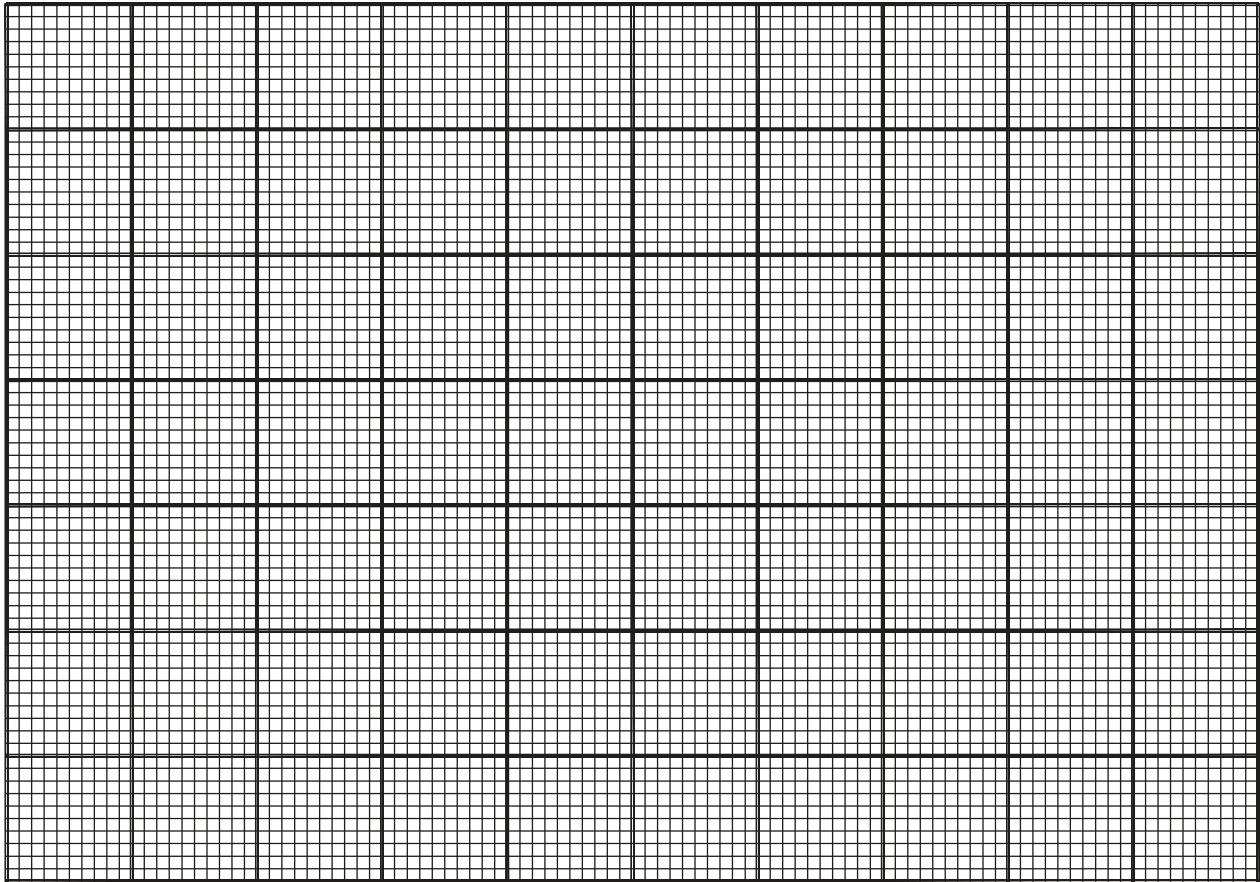

SPECIFICATIONS

1. Trees, stumps, debris and fence, or other structures specified below, shall be removed from within work limits prior to construction.
2. Drainpipe shall meet ASTM _____ specifications.
3. Drainpipe shall have a minimum earth cover of _____ inches.
4. Trench bed shall be finished true to line and grade, compact, and shaped to provide continuous and uniform support to drain pipe.
5. Gap or opening between joints shall not exceed _____ inches.
6. Connections for joining two (2) lines must be sealed with mortar unless manufactured connections are used.
7. Tile shall be blinded by end of day's work with minimum cover depth of 6 inches. Blinding material shall consist of loose, mellow topsoil or filter material firmly tamped around pipe so that it will not be displaced.
8. Outlet, junctions, vents, shall be provided as listed.
9. Tile must be inspected by technician prior to installing.
10. The upper ends of drain lines must be closed with concrete or other durable material.
11. Construction will begin at the outlet end and proceed upstream and the pipe laid immediately following the digging operation.
12. Where rock is exposed, the minimum clearance between conduit and rock shall be 2 inches.